Airport to Laura Village One line Dwg.

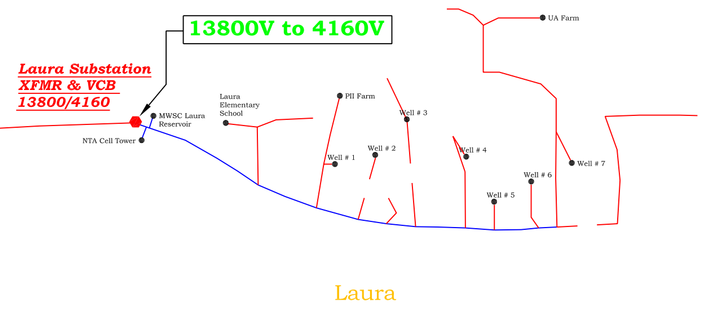

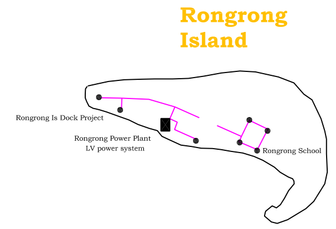

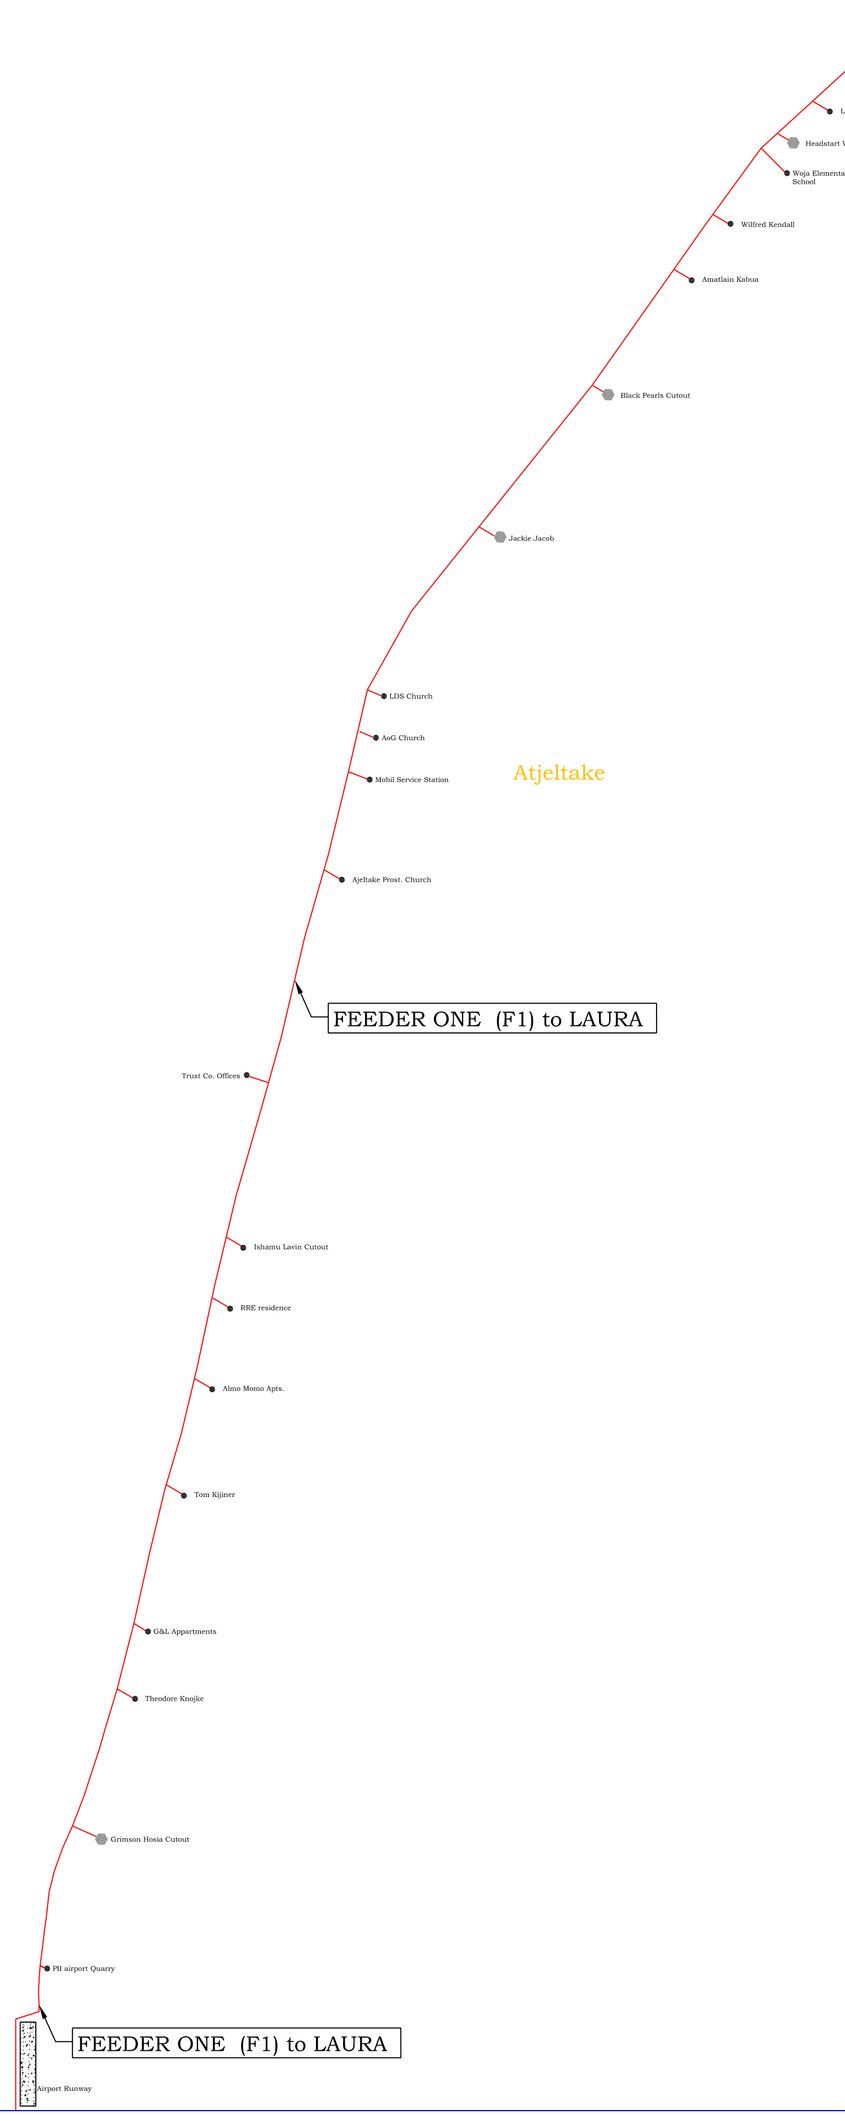

Marshalls Energy Company Inc.

Majuro Distribution System

Guide to symbols used.

- HV Padmount Switch cutouts
- Customer has their own standby Generator.
- Particular customer location for reference.
- (Reference location) for a VCB NOTE: All VCB's supply 3 Phase Overcurrent and Ground Fault Protection.
- Underground service cable
- Overhead service cable

MARSHALLS ENERGY COMPANY Inc. - Distribution System One Line Diagram.